
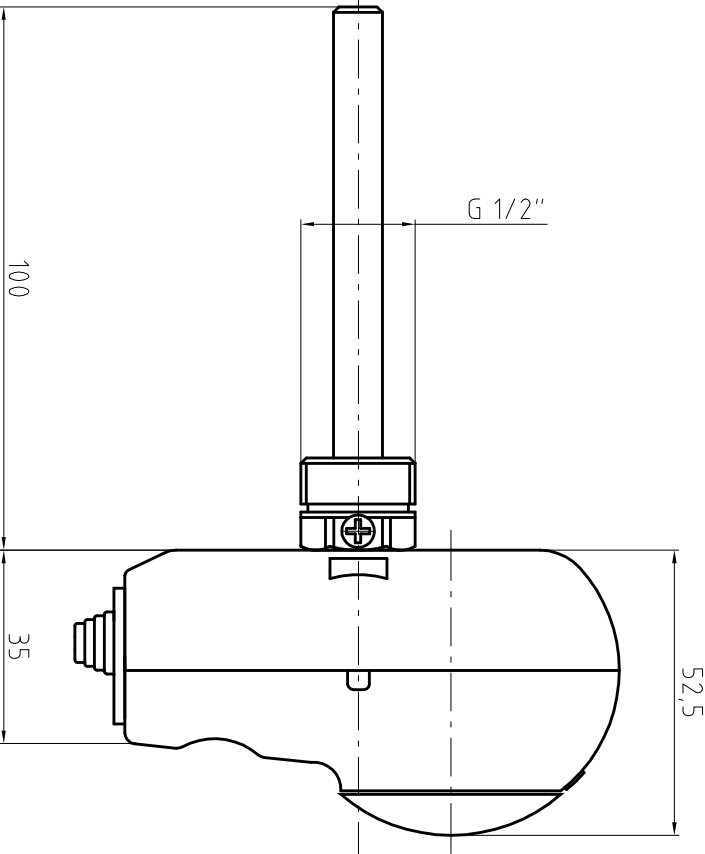
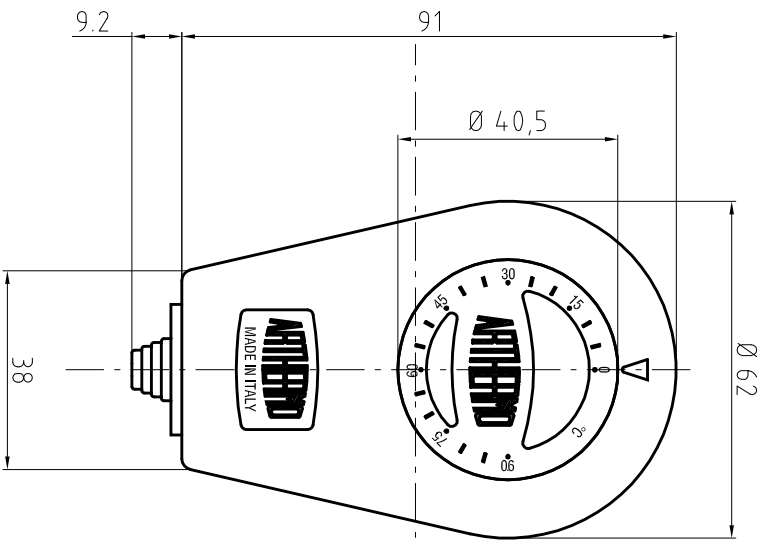


SIEMA DI FISSAGGIO  
FIXING SYSTEM

SCHEMA ELETTRICO / ELECTRIC DIAGRAM  
S.P.D.T.



DATI TECNICI - THECNICAL DATA

|                                       |                                                      |
|---------------------------------------|------------------------------------------------------|
| SCALA RANGE:                          | 0/90°C                                               |
| DIFFERENZIALE / DIFFERENTIAL:         | 4 ± 2,5°C                                            |
| TOLL. VALORI F.S.                     | ± 3°C                                                |
| CAPILLARE / CAPILLARY:                | POZZETTO G 1/2" / POCKET G 1/2"                      |
| INVOLUCRO MANOPOLA / CASE:            | LIGHT BLUE PANTONE 2995C<br>RED KNOB - WHITE NUMBERS |
| SERIGRAFIA / DIAL:                    | C1 15(I)A 400 VAC - C2 2,5(I).6IA 400 VAC            |
| PORTATA CONTATTI / BREAKING CAPACITY: | 200 mA                                               |
| MINIMUM CORRENT.:                     | >100 M ohm                                           |
| INSULATION RESISTANCE:                | 100.000 CICLI / CYCLES                               |
| TEST DI VITA / LIFE OF PRODUCT:       | 70°C                                                 |
| MAX °C SOPR. CORPO / MAX °C CASE      | IP 40                                                |
| GRADO TENUTA / IP GRADE:              |                                                      |

| MODIFICA |  | DOC RIF. | DATA | APPARECCHIO ASSIEME |  |
|----------|--|----------|------|---------------------|--|
| 1        |  |          |      | ARTH100             |  |
| 2        |  |          |      | MATERIALE           |  |
| 3        |  |          |      | TRATTAMENTO         |  |
| 4        |  |          |      | NOTE                |  |
| 5        |  |          |      |                     |  |

|                   |                   |
|-------------------|-------------------|
| DESIGNATO A. SALA | APPROVATO SALA A. |
| SCALA 1 : 1       | DATA 11/11/2011   |
| CODICE            | ARTH100           |